



**G3432.05-113-11-R1**  
**ACOUSTICAL PERFORMANCE TEST REPORT**  
**ASTM E 90 AND ASTM E 492**

**Rendered to**

**CALI BAMBOO**

**Series/Model: Wintermist Cork Flooring with Cali Complete™**

**Specimen Type: 152 mm Concrete Slab with Drop Ceiling**

**Overall Size: 3023 mm by 3632 mm**

**STC     62**  
**IIC     68**

**Test Specimen Identification:**

Floor Topping: 10.8 mm Cali Bamboo Wintermist Cork Flooring

Floor Underlayment: 1.5 mm Cali Complete™ Vinyl Flooring Underlayment

Floor Slab: 152 mm Concrete Slab

Main Beams: 43 mm Armstrong HD8906 Drywall Main Beam

Cross Tees: 37.3 mm Armstrong XL8945P Cross Tee

Insulation: 88.9 mm Johns Manville Kraft Faced R-13 Fiberglass Insulation

Ceiling: 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel

Reference should be made to Intertek-ATI Report G3432.05-113-11 for complete test specimen description. This page alone is not a complete report.



## Acoustical Performance Test Report

CALI BAMBOO  
6675 Mesa Ridge Road #100  
San Diego, California 92121

<b>Report</b>	G3432.05-113-11
<b>Test Date</b>	10/27/16
<b>Report Date</b>	11/01/16
<b>Revision Date</b>	11/08/16

### Project Scope

Architectural Testing, Inc., an Intertek company (Intertek-ATI), was contracted to conduct airborne sound transmission loss and impact sound transmission tests. The complete test data is included as attachments to this report. The full test specimen was assembled on the day of testing by Intertek-ATI. All materials provided by the client were installed on an existing Intertek-ATI assembly (152 mm Concrete Slab with Drop Ceiling) utilizing Intertek-ATI-

### Test Methods

The acoustical tests were conducted in accordance with the following standards. The equipment listed in the attachments meets the requirements of the following standards.

ASTM E 90-09, Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions

ASTM E 413-10, Classification for Rating Sound Insulation

ASTM E 492-09(2016)e1, Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine

ASTM E 989-06 (2012), Classification for Determination of Impact Insulation Class (IIC)

ASTM E 2235-04 (2012) Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods

### Test Procedure

All testing was conducted in the VT test chambers at Intertek-ATI located in York, Pennsylvania. The microphones were calibrated before conducting the tests.

The airborne transmission loss test was conducted in accordance with the ASTM E 90 test method using the single direction method. Two background noise sound pressure level and five sound absorption measurements were conducted at each of five microphone positions. Four sound pressure level measurements were made simultaneously in both rooms, at each of five microphone positions.

**Test Procedure (Continued)**

The impact sound transmission test was conducted in accordance with the ASTM E 492 test method. Two background noise sound pressure level, two sound pressure level measurements with the tapping machine operating at each position specified by ASTM E 492, and five sound absorption measurements were conducted at each of five microphone positions.

The air temperature and relative humidity conditions were monitored and recorded during all measurements.

**Test Conditions**

Source Room		Receive Room	
Average Temperature	19°C	Average Temperature	20.2°C
Average Relative Humidity	42%	Average Relative Humidity	49%

**Test Calculations**

The STC (Sound Transmission Class) and IIC (Impact Insulation Class) ratings were calculated in accordance with ASTM E 413 and ASTM E 989, respectively.

**Test Specimen Materials and Installation Details**

Material	Dimensions (mm)	Thickness (mm)	Manufacturer and Series	Quantity	Average Weight
Cork Flooring	1219 by 127	10.8	Cali Bamboo Wintermist	10.98 m <sup>2</sup>	8.45 kg/m <sup>2</sup>
	<i>Note: Loose laid</i>				
Vinyl Flooring Underlayment	1180 by 3048	1.5	Cali Complete™	10.98 m <sup>2</sup>	0.41 kg/m <sup>2</sup>
	<i>Note: Loose laid</i>				
Concrete Slab	3023 by 3632	152.0	N/A	10.98 m <sup>2</sup>	366.18 kg/m <sup>2</sup>
	<i>Note: The concrete slab was installed in a test frame flush to the source room.</i>				
Drywall Main Beam	38.1 by 2870	43.0	Armstrong HD8906	10.9 lin m	0.45 kg/m
	<i>Note: Twelve gauge hanger wires were attached to the bottom side of the concrete at twelve locations and then to the main beams. The hanger wire was twisted around itself a minimum of three times within 76 mm creating a 305 mm plenum. The measured steel thickness was 0.5 mm.</i>				
Cross Tee	38.3 by 1219	37.3	Armstrong XL8945P	27.2 lin m	0.45 kg/m
	<i>Note: Inserted into the main beams on 610 mm centers. The measured steel thickness was 0.5 mm.</i>				
Fiberglass Insulation	2962 by 584	88.9	Johns Manville Kraft Faced R-13	10.98 m <sup>2</sup>	1.33 kg/m <sup>2</sup>
	<i>Note: Loose laid onto the ceiling grid system</i>				
Gypsum Panel	3023 by 1219	15.9	National Gypsum Gold Bond® Fire-Shield® Type X	10.56 m <sup>2</sup>	11.23 kg/m <sup>2</sup>
	<i>Note: Fastened with fine thread drywall screws on 305 mm centers</i>				

## Comments

The total weight of the floor/ceiling assembly was 4268.2 kg. Intertek-ATI will store samples of the test specimen for four years. Photographs of the test specimen are included in the attachments. A drawing of the test specimen is included in the attachments.

Intertek-ATI will service this report for the entire test record retention period. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by Intertek-ATI for the entire test record retention period. The test record retention period ends four years after the test date.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen tested. This report is intended to help in the client's quality assurance program, but it does not represent a continuous or exhaustive evaluation of the specimen tested or of other products or materials that were not evaluated. The statements and data provided herein do not constitute approval, disapproval, certification, or acceptance of performance or materials.

**This report may not be reproduced, except in full, without the written approval of Intertek-ATI.**

FOR INTERTEK-ATI:

---

Cody R. Snyder  
Technician II - Acoustical Testing

---

Jordan Strybos  
Project Manager - Acoustical Testing

Attachments (7 pages): This report is complete only when all attachments listed are included.

- Instrumentation (1)
- Airborne Sound Transmission Loss Data (2)
- Impact Sound Transmission Data (2)
- Photographs (1)
- Drawings (1)

\* *Stated by Client/Manufacturer*

*N/A - Non Applicable*

### Revision Log

<b>Revision</b>	<b>Date</b>	<b>Page(s)</b>	<b>Description</b>
R0	11/01/16	N/A	Original Report Issue
R1	11/08/16	Cover page, Page 2, Datasheets	Underlayment name changed per client's request

## Attachments

### Instrumentation

Instrument	Manufacturer	Model	ATI Number	Date of Calibration
Data Acquisition Unit	National Instruments	PXI-1033	65124	06/16 *
Microphone Calibrator	Norsonic	1251	INT00127	01/16
Receive Room Microphone	PCB Piezotronics	378B20	63748	06/16
Receive Room Microphone	PCB Piezotronics	378B20	63744	06/16
Receive Room Microphone	PCB Piezotronics	378B20	63745	06/16
Receive Room Microphone	PCB Piezotronics	378C20	65617	06/16
Receive Room Microphone	PCB Piezotronics	378B20	63747	06/16
Receive Room Environmental Indicator	Comet	T7510	63810	10/15
			63811	10/15
Source Room Microphone	PCB Piezotronics	378B20	63738	05/16
Source Room Microphone	PCB Piezotronics	378B20	63739	05/16
Source Room Microphone	PCB Piezotronics	378B20	63740	05/16
Source Room Microphone	PCB Piezotronics	378B20	63742	05/16
Source Room Microphone	Scantek	378B20	63741	05/16
Source Room Environmental Indicator	Comet	T7510	63812	11/15
Tapping Machine	Look Line s.r.l.	EM50 (TM50)	65351	02/16

\* The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

### Test Chambers

VT Receive Room Volume	155.77 m <sup>3</sup>
VT Source Room Volume	190 m <sup>3</sup>



G3432.05-113-11-R1

**AIRBORNE SOUND TRANSMISSION LOSS**  
ASTM E 90



<b>Test Date</b>	10/27/16
<b>Data File No.</b>	G3432.05
<b>Client</b>	Cali Bamboo
<b>Description</b>	10.8 mm Cali Bamboo Wintermist Cork Flooring, 1.5 mm Cali Complete™ Vinyl Flooring Underlayment, 152 mm Concrete Slab, 43 mm Armstrong HD8906 Drywall Main Beam, 37.3 mm Armstrong XL8945P Cross Tee, 88.9 mm Johns Manville Kraft Faced R-13 Fiberglass Insulation, 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel
<b>Specimen Area</b>	10.98 m <sup>2</sup>
<b>Technician</b>	Cody R. Snyder

Freq (Hz)	Background SPL (dB)	Absorption (m <sup>2</sup> )	Source SPL (dB)	Receive SPL (dB)	Specimen TL (dB)	95% Confidence Limit	Number of Deficiencies
80	37.7	18.7	119	78	40	4.30	-
100	35.4	11.9	110	69	42	1.90	-
125	35.0	10.8	104	64	41	1.20	5
160	28.3	10.2	105	64	42	1.40	7
200	27.1	10.5	104	56	50	1.00	2
250	26.2	10.6	102	53	51	0.80	4
315	25.2	9.9	105	52	55	0.80	3
400	22.2	8.7	103	49	56	0.70	5
500	22.6	7.9	102	44	60	0.80	2
630	25.6	7.4	101	41	64	0.50	0
800	26.3	7.8	101	38	66	0.50	0
1000	23.5	7.7	101	37	67	0.40	0
1250	20.5	7.8	100	35	67	0.40	0
1600	16.9	8.0	100	35	68	0.30	0
2000	12.7	8.9	100	34	68	0.40	0
2500	9.2	10.1	96	31	67	0.60	0
3150	7.8	10.9	98	28	71	0.60	0
4000	6.2	12.5	98	26	71	0.40	0
5000	5.9	14.5	95	21	74	0.50	-
6300	6.2	17.7	92	13	78	0.70	-
8000	6.6	24.5	93	12	79	1.20	-
10000	6.8	29.5	91	8	80	0.80	-


**STC Rating**      **62**      (*Sound Transmission Class*)

**Deficiencies**      **28**      (*Sum of Deficiencies*)

- Notes:**
- 1) Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.
  - 2) Specimen TL levels listed in red indicate the lower limit of the transmission loss.
  - 3) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

**AIRBORNE SOUND TRANSMISSION LOSS**  
ASTM E 90

<b>Test Date</b>	10/27/16
<b>Data File No.</b>	G3432.05
<b>Client</b>	Cali Bamboo
<b>Description</b>	10.8 mm Cali Bamboo Wintermist Cork Flooring, 1.5 mm Cali Complete™ Vinyl Flooring Underlayment, 152 mm Concrete Slab, 43 mm Armstrong HD8906 Drywall Main Beam, 37.3 mm Armstrong XL8945P Cross Tee, 88.9 mm Johns Manville Kraft Faced R-13 Fiberglass Insulation, 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel
<b>Specimen Area</b>	10.98 m <sup>2</sup>
<b>Technician</b>	Cody R. Snyder

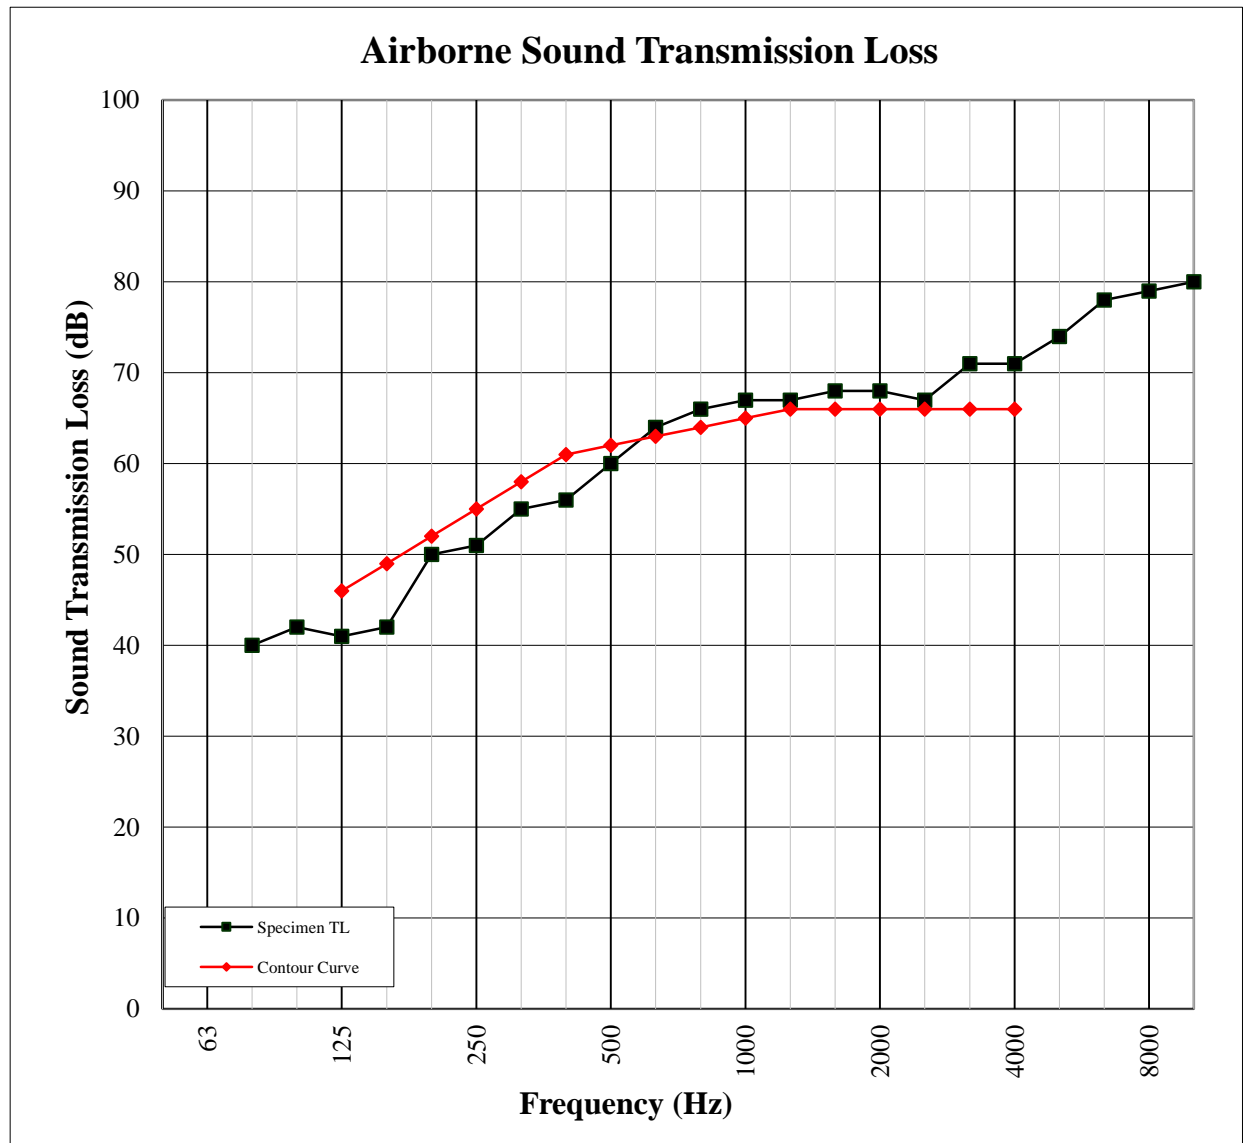





G3432.05-113-11-R1



**IMPACT SOUND TRANSMISSION**  
ASTM E 492

<b>Test Date</b>	10/27/16
<b>Data File No.</b>	G3432.05
<b>Client</b>	Cali Bamboo
<b>Description</b>	10.8 mm Cali Bamboo Wintermist Cork Flooring, 1.5 mm Cali Complete™ Vinyl Flooring Underlayment, 152 mm Concrete Slab, 43 mm Armstrong HD8906 Drywall Main Beam, 37.3 mm Armstrong XL8945P Cross Tee, 88.9 mm Johns Manville Kraft Faced R-13 Fiberglass Insulation, 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel
<b>Specimen Area</b>	10.98 m <sup>2</sup>
<b>Technician</b>	Cody R. Snyder

<b>Freq</b> (Hz)	<b>Background SPL</b> (dB)	<b>Absorption</b> (m <sup>2</sup> )	<b>Normalized Impact SPL</b> (dB)	<b>95% Confidence Limit</b>	<b>Number of Deficiencies</b>
80	40.0	16.2	48	2.8	-
100	35.3	12.6	49	1.5	5
125	36.7	11.1	47	1.8	3
160	33.7	9.9	48	3.5	4
200	27.4	10.4	47	0.7	3
250	26.4	10.8	50	1.4	6
315	24.6	9.8	47	0.8	3
400	21.8	8.5	46	0.8	3
500	24.2	8.2	41	1.0	0
630	24.9	7.5	38	0.3	0
800	25.0	7.7	33	0.6	0
1000	22.8	7.6	27	0.4	0
1250	19.9	7.8	23	0.4	0
1600	17.5	7.9	21	0.3	0
2000	11.9	9.0	15	0.3	0
2500	7.1	10.1	9	0.1	0
3150	5.8	10.8	5	0.1	0
4000	5.3	12.4	5	0.3	-
5000	5.7	14.2	6	0.4	-
6300	6.2	17.8	7	0.5	-
8000	6.6	24.6	9	0.6	-
10000	6.8	30.1	10	0.8	-


**IIC Rating**      **68**      (*Impact Insulation Class*)

**Deficiencies**      **27**      (*Sum of Deficiencies*)

*Note:*      *Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.*

**IMPACT SOUND TRANSMISSION**  
ASTM E 492

<b>Test Date</b>	10/27/16
<b>Data File No.</b>	G3432.05
<b>Client</b>	Cali Bamboo
<b>Description</b>	10.8 mm Cali Bamboo Wintermist Cork Flooring, 1.5 mm Cali Complete™ Vinyl Flooring Underlayment, 152 mm Concrete Slab, 43 mm Armstrong HD8906 Drywall Main Beam, 37.3 mm Armstrong XL8945P Cross Tee, 88.9 mm Johns Manville Kraft Faced R-13 Fiberglass Insulation, 15.9 mm National Gypsum Gold Bond® Fire-Shield® Type X Gypsum Panel
<b>Specimen Area</b>	10.98 m <sup>2</sup>
<b>Technician</b>	Cody R. Snyder

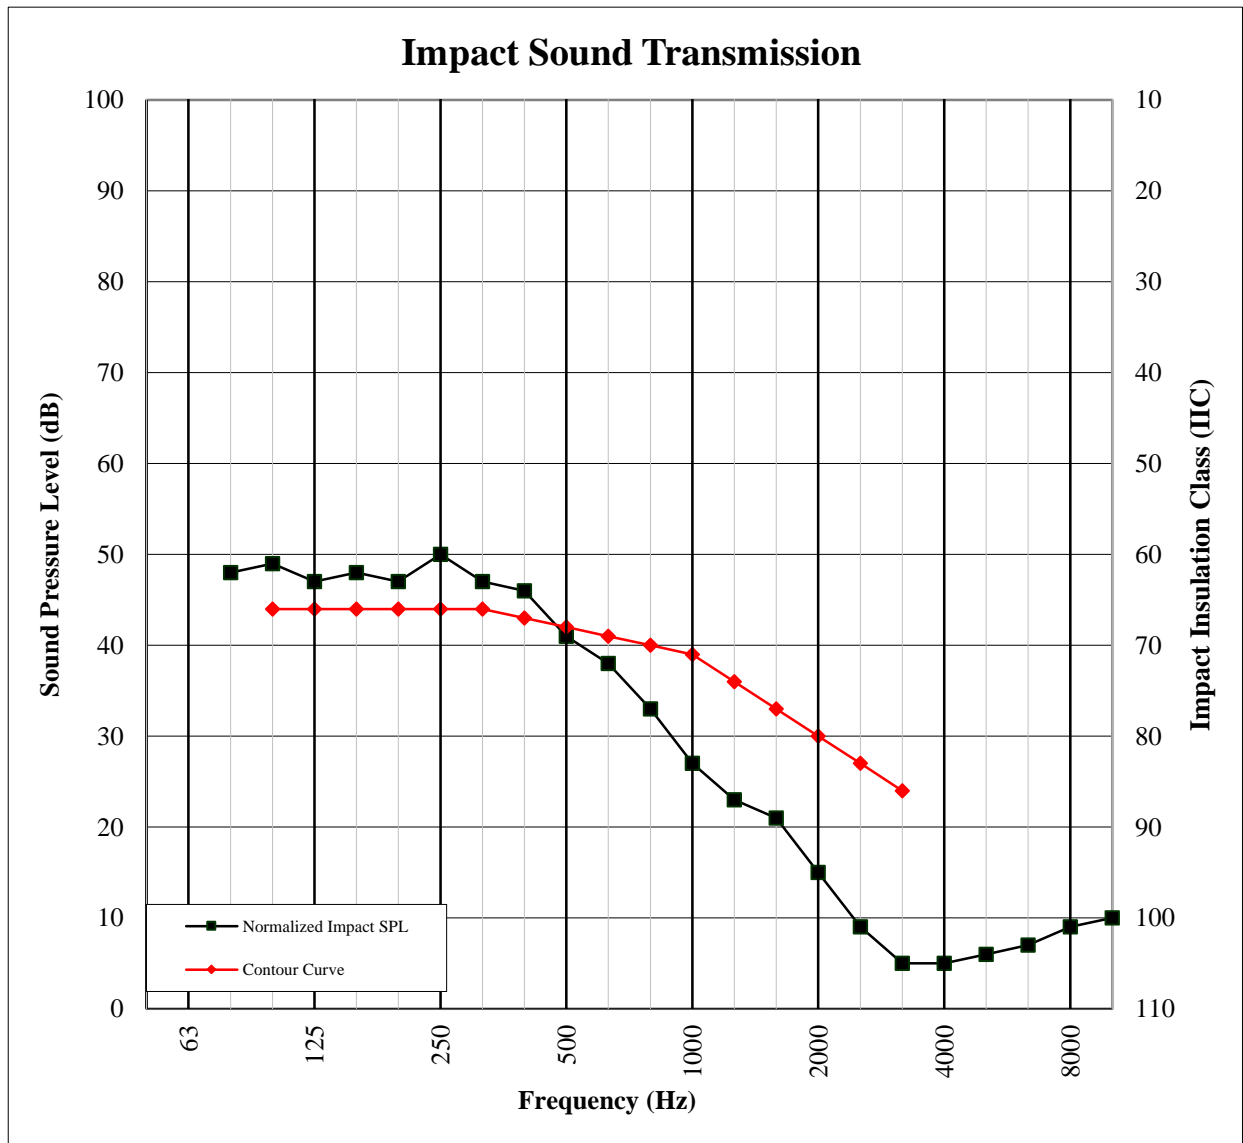

**Photographs**




**Source Room View of Test Specimen Installation**



**Receive Room View of Test Specimen Installation**

**Drawing**

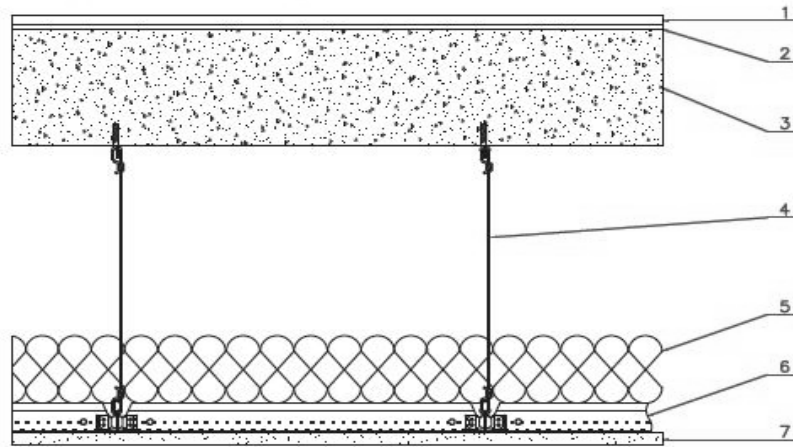

- 1-Floor Topping
- 2-Underlayment
- 3-Concrete Slab
- 4-Hanger Wire
- 5-Insulation
- 6-Ceiling Grid
- 7-Ceiling